



## Certified Product Listing

**For:**

Drinking Water System Components - Health Effects

**Company:**

SealBoss Corporation  
1669 E Wilshire Avenue  
Santa Ana, CA 92705, United States

**Plant Location:**

Santa Fe Springs, CA, United States

**Standards:**

NSF/ANSI/CAN 61 - 2020

**Certificate:**

Issued Date: 12/07/2021

**Material/Product:**

SealBoss 1570LV WaterStopFoam

**Contact Temperature:**

23 ± 2°C

**Models:**

SealBoss 1570LV WaterStopFoam

The crack filler should not exceed more than 5% coverage of the total surface area.



Product certified to NSF/ANSI/CAN 372 conforms to the requirements for "Lead Free" plumbing products as defined by California, Vermont, Maryland and Louisiana state laws and by section 1417 of the US SDWA.



## Material Characteristics:

Minimum tank size (gallons): 1000

Maximum tank surface area/volume ratio (sq in/L): 5.7

Is additional coating required (e.g. top coat, primer, intermediate coat)? (Y/N): Refer to manufacturer instructions for details


Final cure time: 24 hours @ ambient temperature

Mix ratio: 10:1:1

Is this paint/coating system intended to be applied to a pipe? (Y/N): No

Additional comments:

The crack filler should not exceed more than 5% coverage of the total surface area.

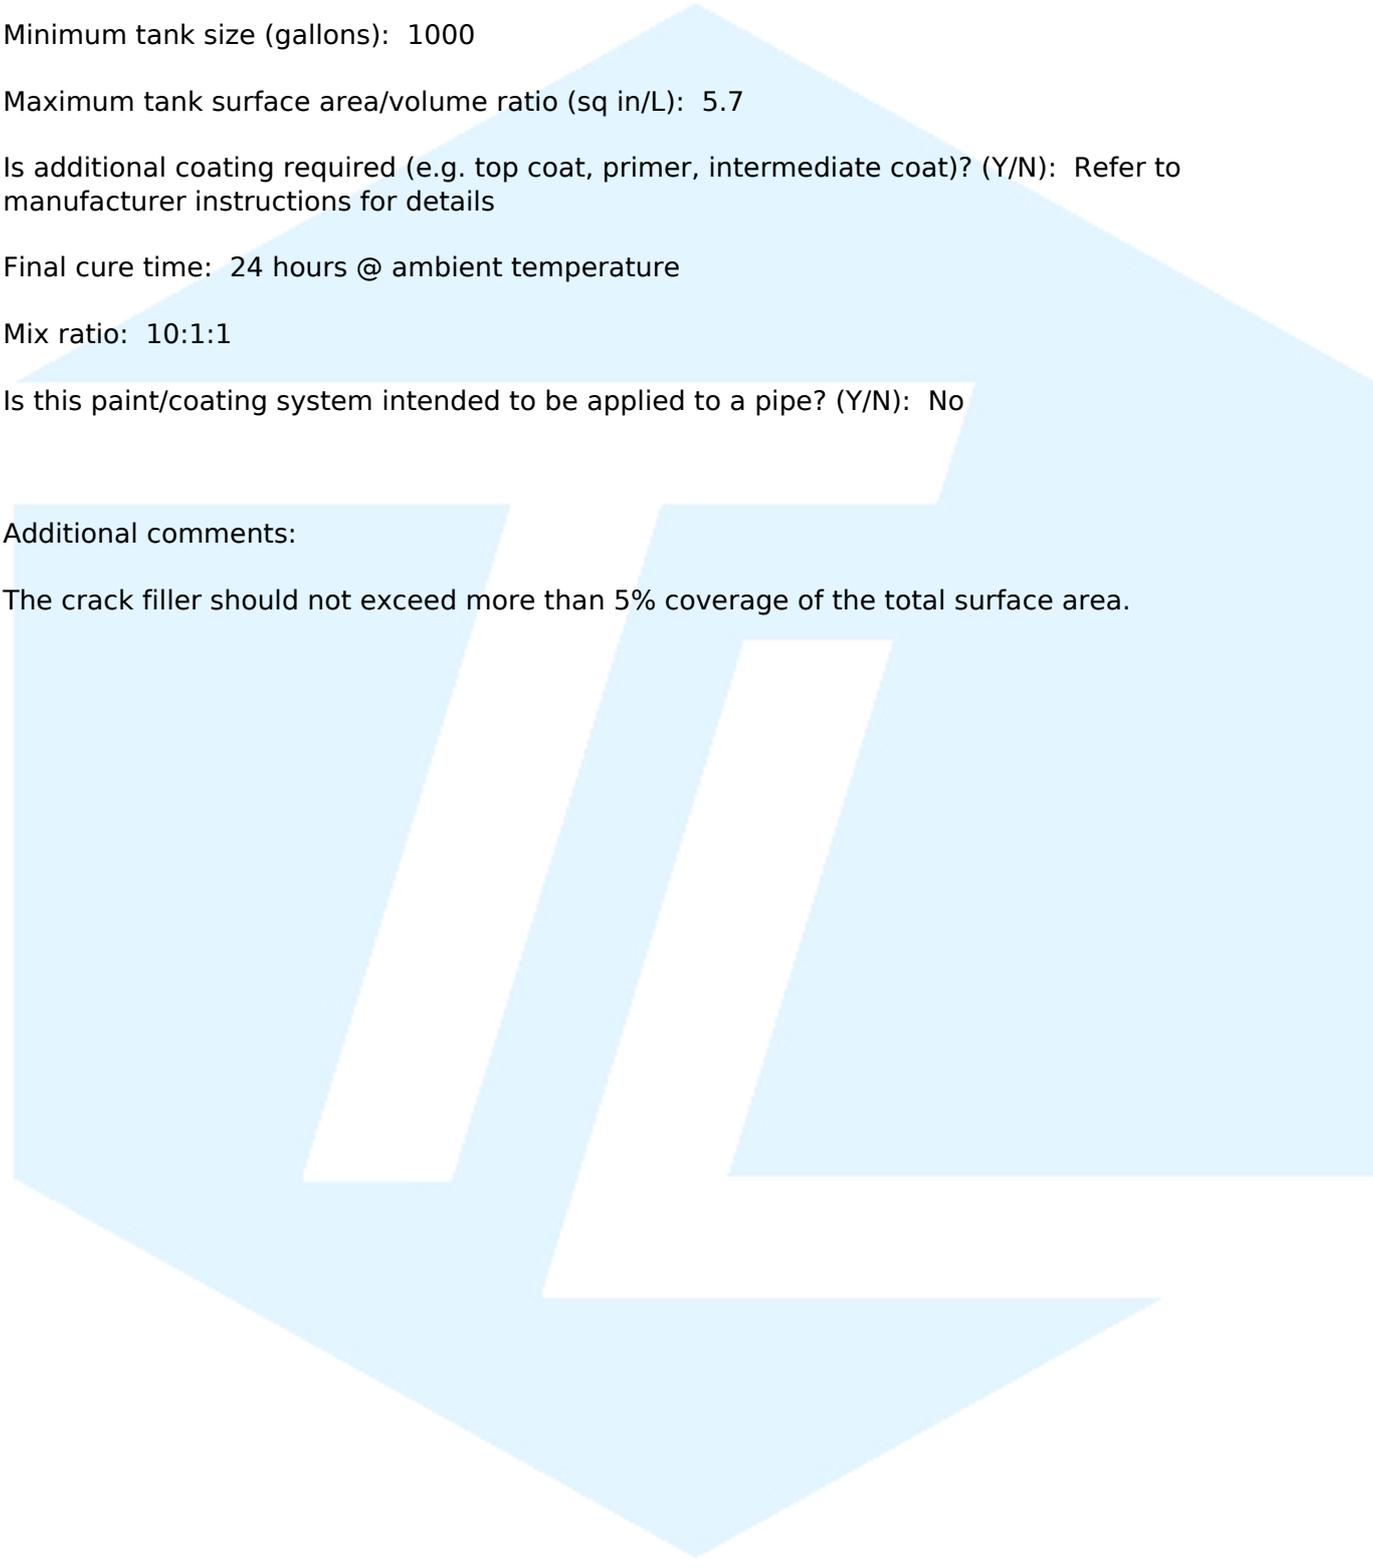

Product certified to NSF/ANSI/CAN 372 conforms to the requirements for "Lead Free" plumbing products as defined by California, Vermont, Maryland and Louisiana state laws and by section 1417 of the US SDWA.